



SOUTHERN POWER DISTRIBUTION COMPANY OF TELANGANA LIMITED

Office of the
Superintending Engineer
Operation, Vikarabad Circle

TENDER NOTIFICATION No.18/25-26

S No	Specification No	Name of the Work	EMD Amount
1	SE/OP/VKB/02/25-26	a) 44 No's 33KV 800A AB Switch Fixed Contacts b) 44 No's 33KV 800A AB Switch Moving Contacts	Rs. 10,000/-

1	Sale of Tender Specifications	16.01.2026 to 23.01.2026 up to 17:00Hrs on all working days
2	Last date of receipt of tender specification	24.01.2026 up to 14:30 Hrs.
3	Date & Time of opening of tender specifications	24.01.2026 at 15.00 Hrs.
4	Cost for Tender Specifications	For above each bid Rs.590/- in the form of Demand Draft favoring TGSPDCL, Vikarabad.

The under signed reserves the right to reject/cancel any or all the tenders without assigning any reasons.

The cost of the tender specification once paid will not be refunded under any circumstances.

Phone Nos.8712469736 or 8712469716

Seelapp
Superintending Engineer,
Operation, Vikarabad Circle

Copy Submitted to:

The Chief Engineer, Rural Zone, Hyderabad

Copy to:

Asst Divisional Engineer/District Stores/Ranga Reddy

Divisional Engineer/Tech & Const/Circle Office

Divisional Engineer/Operation/Vikarabad & Tandur

SAO/Vikarabad

AO/Exp/Vikarabad

Assistant Divisional Engineer/Operation/Vikarabad

Assistant Divisional Engineer/TRE/Vikarabad


It is instructed to attend
for opening of bids on
24.01.2026 at 15:00Hrs
in Vikarabad Circle Office

Name of the Material: 33kV 800A AB Switch Fixed Contact (SAB30001)

Description:-

1. Fixed Arcing horn --- 10mm Dia MS HDG
2. Hood --- MS HDG
3. Fixed Contact Jaw --- 2 Nos 25x4x510mm Tin plated Copper Flat
4. Spacer --- MS HDG (solid)
5. Spring --- 8 Nos. Stainless Steel Springs with Metal reviting on both sides
6. Jaws Bracket --- MS HDG
7. FC Mounting Plate --- MS HDG with 4 Holes 55 mm spacing
8. FC Support Channel --MS HDG 100x50x5mm length 200mm
9. Bi metallic Strip -- 80x60x1mm
10. Jumper pad --- 75x10x175mm Al. Flat with 4 holes 40mm spacing
11. Nut & Bolt --- 3/8 x 2" with 3mm Flat & Spring washer of 4 Microns thickness of Zinc.


NOTE : In assembled form as per Fig

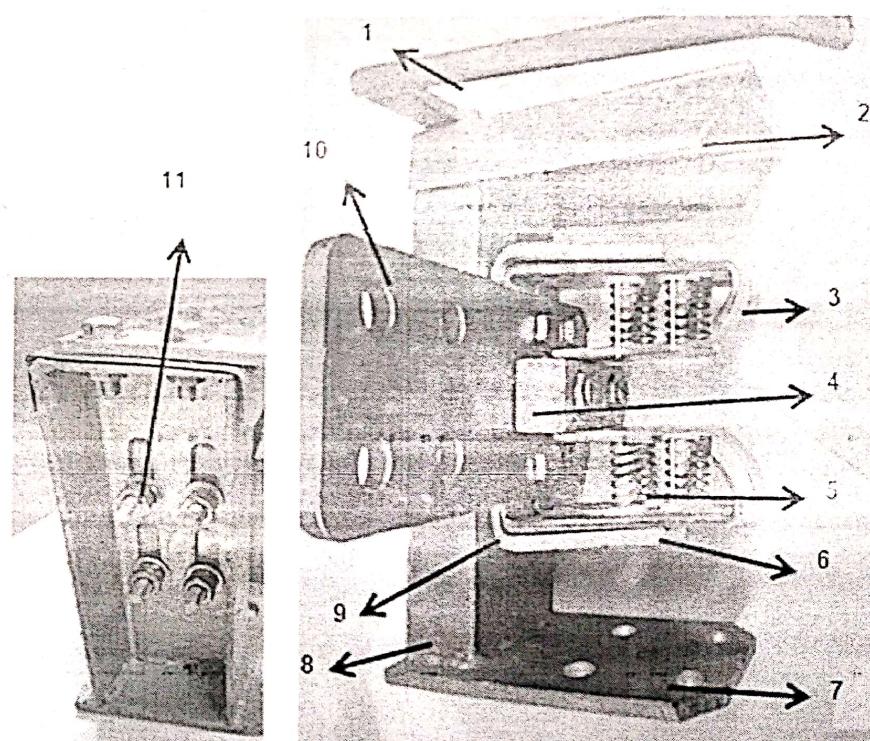

Check Measurement Officer and sample verification officer should signed on this specifications.

Fig 6

Name of the Material: 33KV 800A AB Switch Moving Contact (SAB30002)

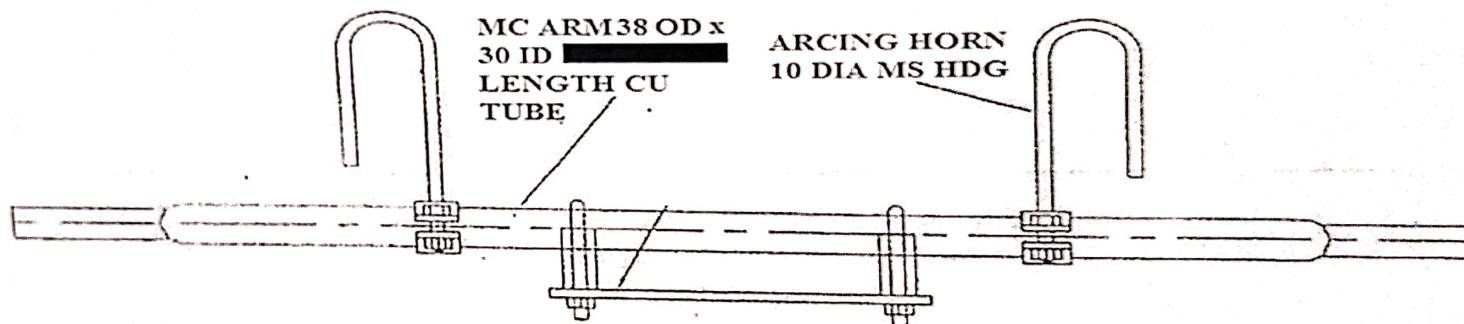

Description :-33kV 800 A AB switch moving contact of size 38 OD x 30 ID Copper Tube with both ends Tin coating.